


REVISION No. 9

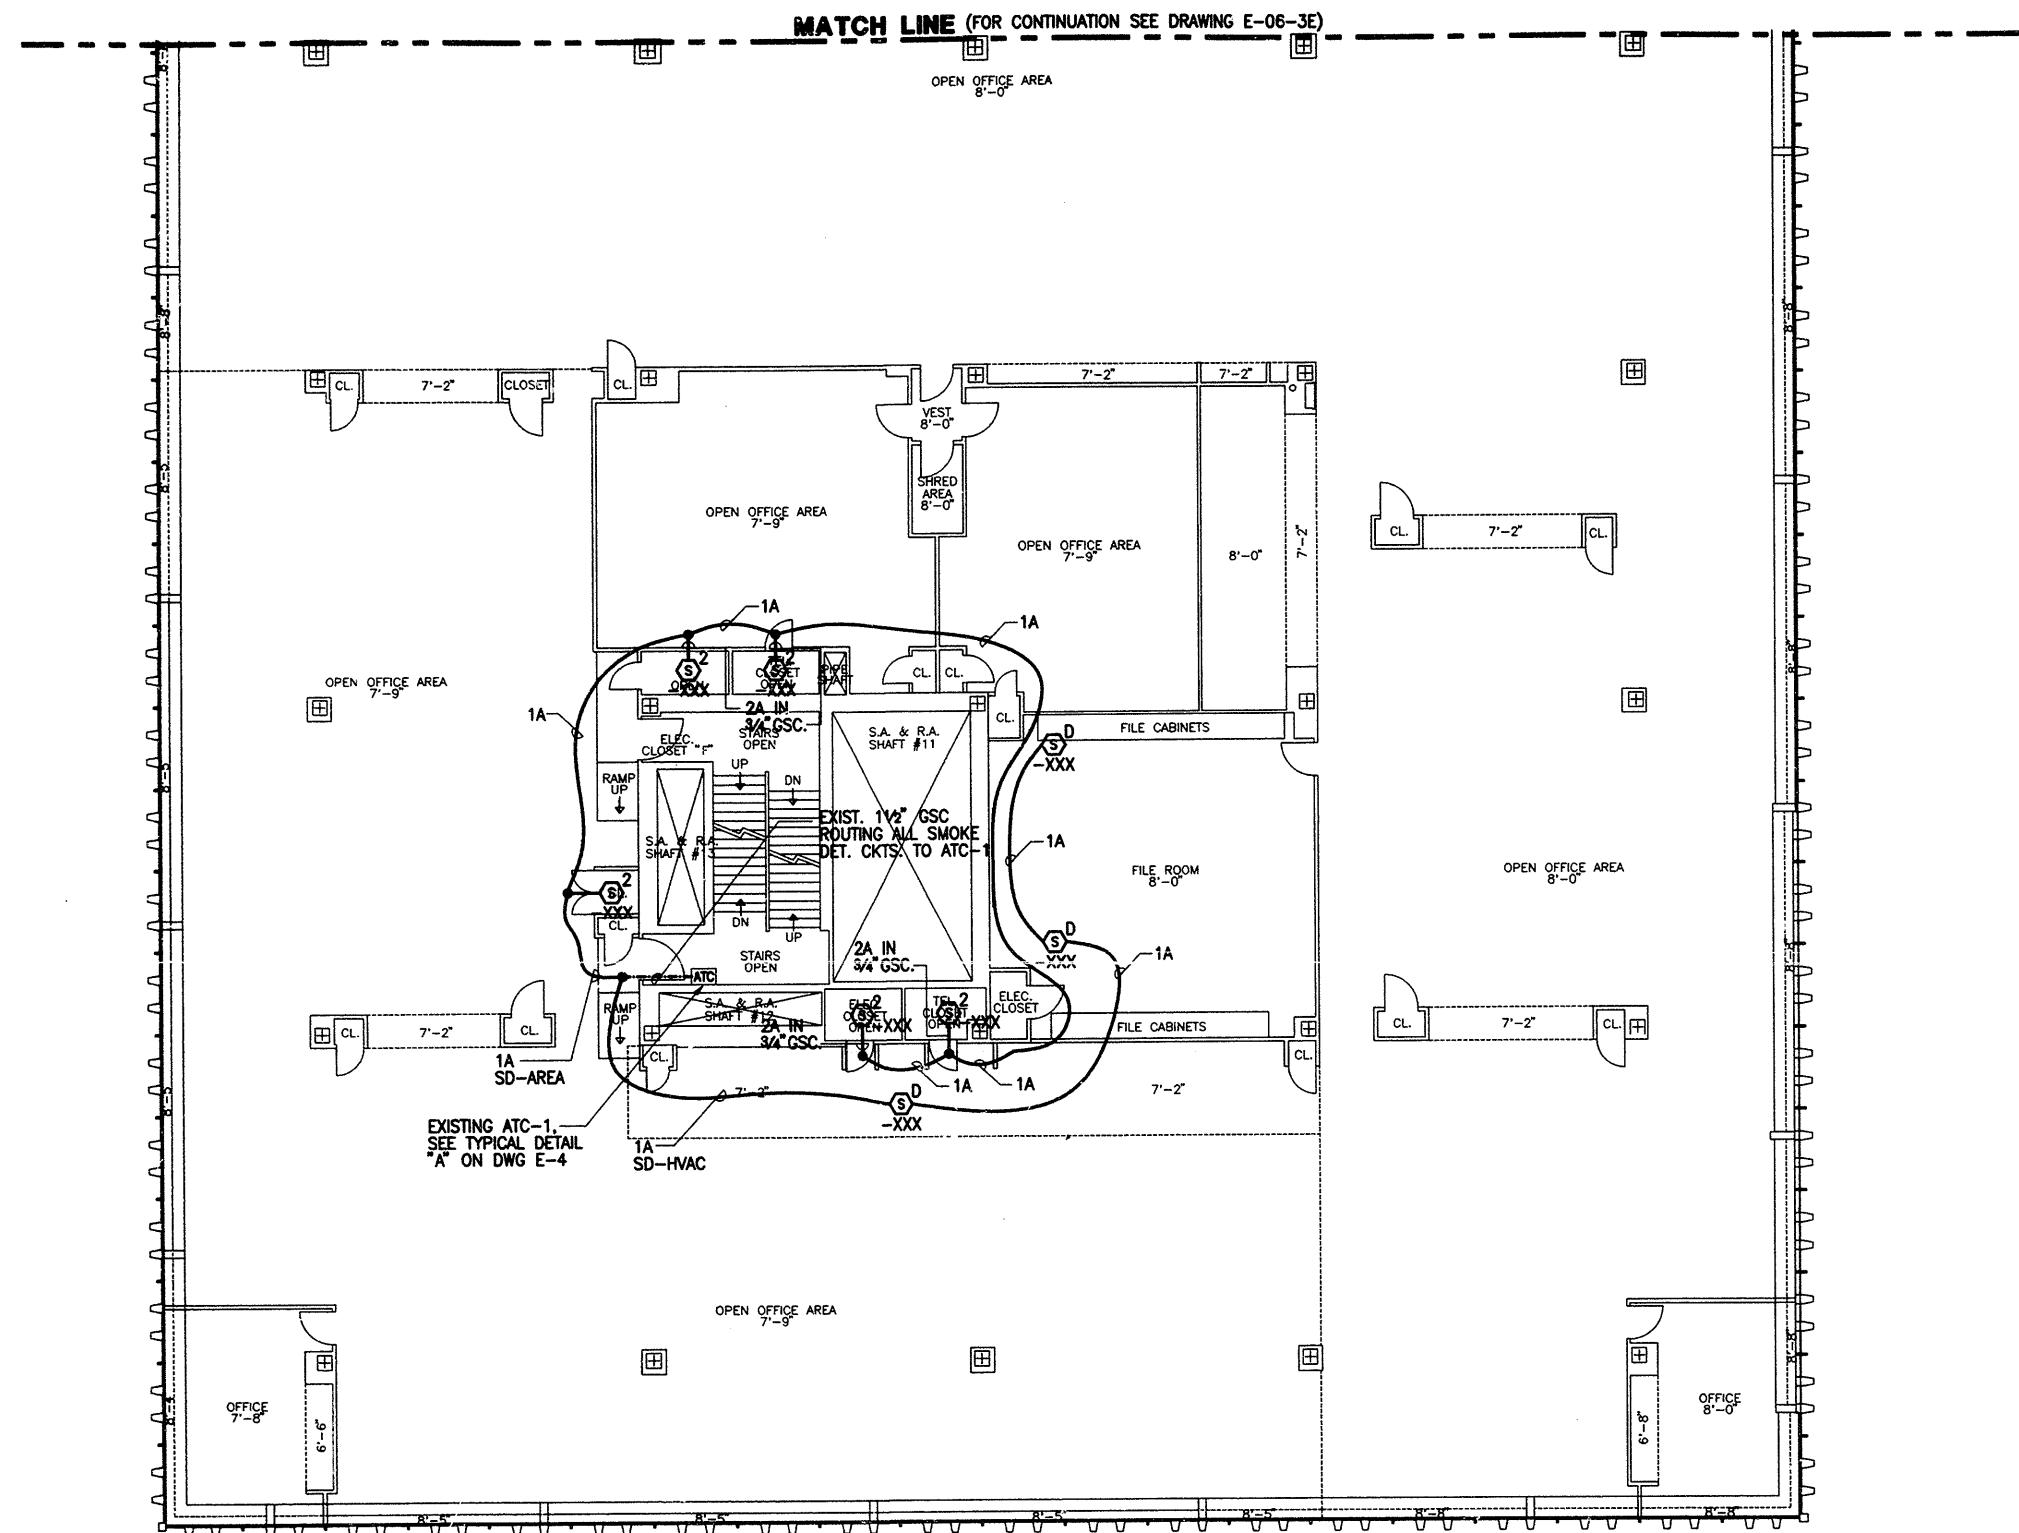

NOTES

1. FOR LEGEND, ABBREVIATIONS, AND GENERAL NOTES, SEE DWG. E-1.
FOR INSTALLATION DETAILS, SEE DWG. E-2. FOR WIRING DIAGRAMS,
SEE DWG. E-3 AND DWG. E-4.
2. NOT USED
3. NOT USED
4. FOR RETURN AIR SMOKE DETECTORS ARRANGEMENT AND NOTES,
SEE DWG. M-1.
5. NOT USED.

Sheet 67 of 84

THE PORT AUTHORITY
OF NY & NJ

[Signature]
ENGINEERING PROGRAM MANAGER
WORLD TRADE
CENTER
CHIEF ELECTRICAL ENGINEER

No. Date Revision Approved

ENGINEERING DEPARTMENT

WORLD
TRADE
CENTER

ELECTRICAL

Title
**FIRE ALARM SYSTEM
DEVICE UPGRADE
PHASE III
5 WTC 3rd, 4th, 5th & 6th FLOORS**

**6th FLOOR
SMOKE DETECTOR
INSTALLATION
SOUTH PART PLAN**

This drawing subject to conditions in Contract. All
inventions, ideas, designs and methods herein are
reserved to Port Authority and may not be used
without its written consent.

FELDSSTEIN KOBZAN A.S.
Designed by Drawn by Checked by

NOVEMBER 26, 1999
Date

WTC-861.573 E-06-3S
Contract Number Drawing Number

I HEREBY CERTIFY THAT THIS IS A TRUE AND
CORRECT COPY OF ONE OF THE CONTRACT
DRAWINGS CONSTITUTING A PART OF
CONTRACT NO. **WTC-861.573** IN
THE FORM IN WHICH SAID DRAWINGS
EXISTED AT THE TIME THE SAID CONTRACT
WAS EXECUTED BY THE PARTIES.

DATE **2/1/00** *[Signature]*
CONTRACT ENGR/ARCH.

DATE **2/1/00** *[Signature]*
ENGINEERING PROGRAM MGR

